



## ARCHAEOLOGY MUSEUM (in the park of Schloss Eggenberg)

Eggenberger Allee 90


8020 Graz

T +43 316 8017-9560

[archaeologie@museum-joanneum.at](mailto:archaeologie@museum-joanneum.at)

[www.museum-joanneum.at/en/](http://www.museum-joanneum.at/en/)

[archaeology-museum-schloss-eggenberg](http://archaeology-museum-schloss-eggenberg)

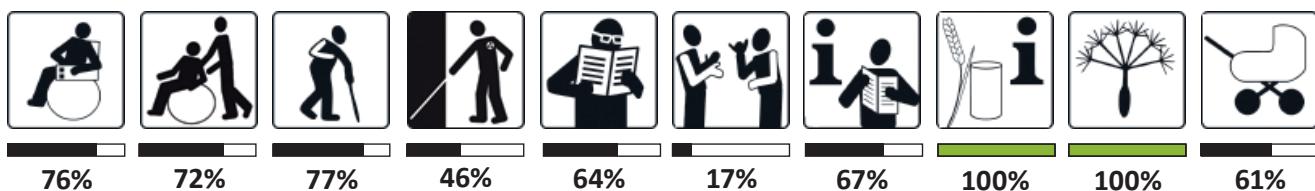

### General information

- Information on the accessibility of the Archaeology Museum is available online
- This information is provided in an accessible format
- People with disabilities can take part in the usual guided tours
- Special tours for people with disabilities are available by prior arrangement
- Guided tours for children are offered, as well as multilingual tours
- A wheelchair can be borrowed free of charge
- Reduced admission for people with disabilities, free admission for assistants
- **No written information designed for people with disabilities** (easy language, Braille)
- Assistance dogs are welcome.
- Evacuation plan for people with disabilities available
- **No orientation or escape plan available**
- There is an audible alarm, but **no visual alarm**
- Changing table is located in the accessible toilet at the park entrance
- Every Friday from 5 to 6 p.m., the Archaeology Museum offers a quiet hour. During this time, a calm and low-stimulus environment is created that is particularly suitable for visitors with sensory sensitivity. Lighting and background noise are dimmed to enable a relaxed museum visit.

## ACCESSIBILITY

### Accessibility by public transport

Please use the route planner of Verbundlinie Steiermark:  
<https://verkehrsauskunft.verbundlinie.at/>

### Parking

- 2 public disabled parking spaces directly in front of the park entrance
- **The parking spaces are approx. 600 m from the entrance to the Archaeology Museum.**
- If necessary, cars and taxis may drive up to the museum, but may not park there. There is a bell at the park entrance to open the gate automatically. .

## INFORMATION FOR WHEELCHAIR USERS AND PEOPLE WITH REDUCED MOBILITY

### PARKING SPACES AND TICKET OFFICE AT PARK ENTRANCE

- **Parallel to the road**, on level ground
- Flooring easy to roll on and low vibration
- Clearly marked with wheelchair symbol on sign (but no marking on the ground)
- Contrasting colour marking of the parking space boundary
- **Parking space and path to the entrance not covered**
- Pavement accessible without steps
- Entrance gate to the park is usually open, clear width at least 90 cm
- Cash desk accessible without thresholds
- Visual and verbal contact between wheelchair users and staff is possible
- Movement area of at least 150 x 150 cm in front of the counter
- **No lowered area with a maximum height of 85 cm, no under-desk wheelchair access**
- credit card machine usable at a height of 80–110 cm
- Price lists and information at standard height



Parking spaces and ticket office park entrance



Cash desk at park entrance

## BARRIER-FREE TOILET AT THE PARK ENTRANCE/TICKET OFFICE

- Accessible without thresholds
- Separately located (unisex)
- Movement area of 150 x 150 cm available in the toilet room



Barrier-free WC at park entrance

### Toilet access door

- Automatic sliding glass door

### Toilet access door

- Hinged door, min. 80 cm clear passage, no threshold
- Easy to open, no door closer
- Door opens outwards and can be unlocked from the outside in an emergency
- On the opening side of the door, approach area of at least 200 x 150 cm, on the closing side at least 150 x 120 cm
- On the opening side of the door, next to the door handle, there is a side approach area of at least 50 cm, **on the closing side less than 50 cm side approach area**
- Door handles (no twist, knob or shell handles) at standard height (85 - 110 cm)

### WC

- Toilet accessible from the right, with at least 90 cm of space for manoeuvring on this side
- in front of the toilet bowl, at least 120 cm space for manoeuvring
- Distance between the front edge of the toilet and the rear wall at least 65 cm
- **Toilet seat height 43 cm** (standard height 46–48 cm), **no backrest**
- Horizontal grab rails on both sides, foldable on the approach side

- Additional vertical grab rail
- **Clearance between horizontal grab rails 81 cm** (standard 65–70 cm)
- **Top edge of horizontal grab rails at a height of 73 cm** (standard 75–85 cm)
- Folding support handle easy to use, securely attached
- Handrails extend at least 15 cm beyond the front edge of the toilet
- Folding support rail protrudes max. 20 cm into the room when folded up
- Toilet paper accessible from a seated position
- Flush at standard height, **not accessible from the toilet while seated**
- **No emergency bell available**

### Washbasin

- In front of the washbasin, there is a movement area of at least 150 x 150 cm
- Clear height under washbasin at least 70 cm, upper edge 80 - 85 cm
- Depth complies with standard, wheelchair-accessible width at least 100 cm
- Flat plaster siphon, siphon made of plastic or protected with porcelain
- Single-lever or touchless tap, distance between tap and front edge of washbasin 20–35 cm

### Other

- Lower edge of mirror higher than 95 cm, but adjustable
- Operating level of fittings (paper and soap dispensers, etc.) at a height of 80–110 cm
- Light switch at standard height (85–110 cm)
- Waste bin operable with one hand

### PATH THROUGH THE PARK AND ENTRANCE TO THE ARCHAEOLOGY MUSEUM

- Path without thresholds, free of obstacles, **not covered**
- Path at least 150 cm wide, **approx. 600 m long (no seating along the path)**
- **Not easily navigable and subject to vibration (broken fine gravel)**
- Path continuously lit
- Path through park completely level, **14% longitudinal gradient in front of museum entrance**
- Cross slope max. 2%
- The main entrance is also the accessible entrance.
- Entrance easy to find, covered, free of obstacles
- Entrance door with a clear width of at least 90 cm, no door threshold



Path through the park



Access to the Archaeology Museum

- Standard hinged door, **difficult to open (door closer)**
- Door handles at standard height, no rotary or shell handles
- On the opening side of the door, approach area of at least 200 x 150 cm, on the closing side at least 150 x 120 cm
- On the opening and closing side of the door, next to the door handle, there is a lateral approach area of at least 50 cm
- Glass door, marked with sufficient contrast, door opening side marked
- Dirt-trapping mat/grating easily accessible with a wheelchair

## CASH DESK


- Cash desk accessible without thresholds
- Visual and verbal contact possible between person in wheelchair and contact person
- Movement area of at least 150 x 150 cm in front of the counter
- **No lowered area with a maximum height of 85 cm, not wheelchair accessible**
- credit card machine usable at a height of 80–110 cm
- Price lists and information at standard height
- Sufficient space in the checkout area
- Seating available (46–50 cm high, with sturdy armrests and backrests)

## CLOAKROOM


- Door to cloakroom: standard hinged door, **difficult to open (door closer)**
- Clear width of at least 80 cm, no door threshold
- Free of obstacles
- Door handles at standard height, no twist or shell handles
- On the opening side of the door, approach area of at least 200 x 150 cm, on the closing side at least 150 x 120 cm



Entrance Archaeology Museum

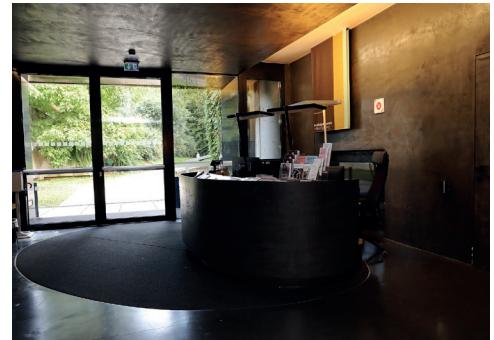

Cash desk

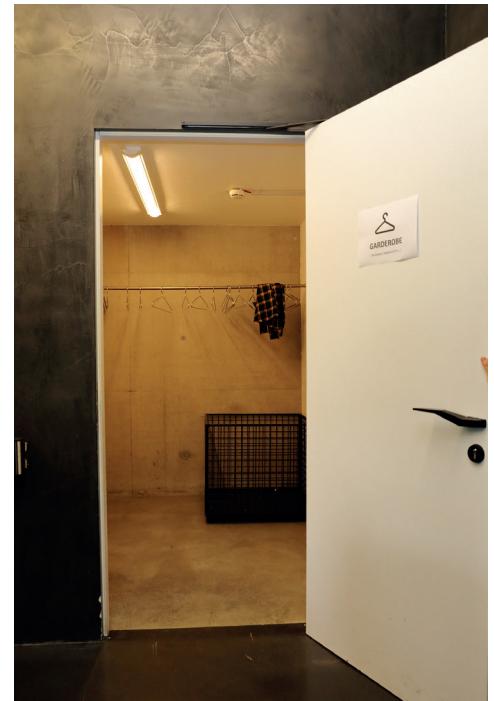

Cloakroom

- On the opening and closing side of the door, next to the door handle, approach area of at least 50 cm
- Glass door, clearly marked with sufficient contrast, door opening side marked
- Wardrobe accessible without threshold
- **Clothes rails higher than 120 cm, coat hooks not at a height of 80–120 cm**
- **No sufficiently sized storage areas available**
- **Lockers higher than 80–100 cm**

## BARRIER-FREE TOILET


- The accessible toilet is also a ladies' toilet.
- Can be opened with a Eurokey!
- Movement area of 150 x 150 cm available in the toilet room

## Door to the toilet facilities

- Hinged door, min. 80 cm clear passage
- Easy to open, **door closer**
- No door threshold
- Space of at least 150 cm diameter on both sides of the door for manoeuvring
- On the opening side of the door, next to the door handle, there is a side approach area of at least 50 cm; **on the closing side, there is no approach area as a fan is in the way**
- Door handles (no rotary, knob or shell handles) at a height of 85–110 cm

## WC door

- Door opens outwards and can be unlocked from the outside in an emergency (with Eurokey)
- Hinged door, min. 80 cm clear passage, no threshold
- Easy to open, no door closer
- On the opening side of the door, approach area of at least 200 x 150 cm, on the closing side at least 150 x 120 cm
- On the opening and closing side of the door, next to the door handle, there is a side approach area of at least 50 cm
- Door handles (no rotary, knob or shell handles) at a height of 85–110 cm

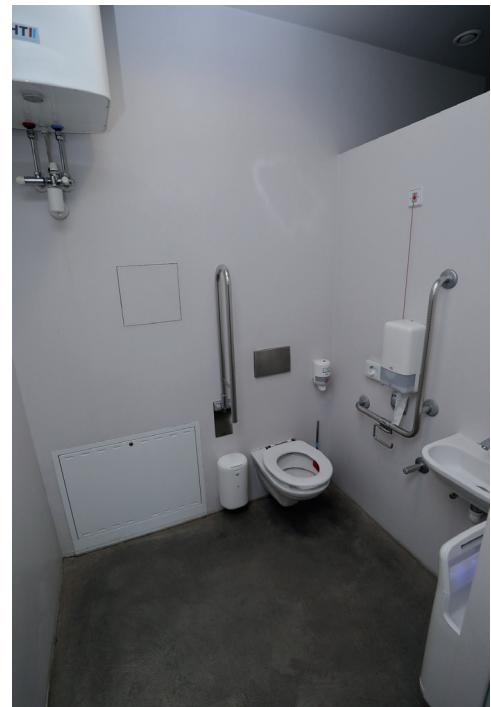

Barrier-free WC

## WC

- Toilet accessible from the left, with at least 90 cm of space on this side for manoeuvring
- **Only 83 cm space for manoeuvring** in front of the toilet bowl (standard min. 120 cm)
- **Distance between the front edge of the toilet and the rear wall only 57 cm** (standard min. 65 cm)
- WC 45 cm high (standard 46 - 48 cm high), **no backrest available**
- Horizontal grab rails on both sides, foldable on the approach side
- Additional vertical grab rail
- Clearance between horizontal grab rails 65–70 cm
- Top edge of horizontal grab rails at a height of 75–85 cm
- Folding support handles securely attached, easy to use
- Handrails protrude at least 15 cm beyond the front edge of the toilet
- Folding support handle protrudes max. 20 cm into the room when folded up
- Toilet paper accessible from a seated position
- Flush at standard height, accessible from the toilet while seated
- Emergency bell available (alarm on site and also leads to reception)
- **Emergency bell not accessible from the toilet while seated**
- **Emergency bell not accessible from the floor at a height of max. 35 cm above the floor**

## Washbasin

- In front of the washbasin in the toilet room **movement area of less than 120 x 120 cm** (standard min. 150 x 150 cm)
- Clear height under washbasin at least 70 cm, upper edge 80 - 85 cm
- **Depth of washbasin less than standard** (35–45 cm for hand washbasins)
- **Wheelchair-accessible width of washbasin less than 100 cm**
- **Centre line of the washbasin to the adjacent wall surface 41 cm** (standard min. 50 cm)
- Flat plaster siphon, plastic siphon or protected with porcelain
- Single-lever mixer tap, **distance between the tap and the front edge of the washbasin not 20–35 cm**
- Additional washbasin in the anteroom, larger movement area in front of the washbasin, **no under-washbasin wheelchair access**

## Other

- Operating level of fixtures (paper and soap dispensers, etc.) at standard height (80–110 cm)
- Coat hooks at a maximum height of 120 cm
- Waste bin can be operated with one hand
- Mirror wall in the anteroom extends to the floor

## INTERIOR AREA


- Paths without thresholds
- Steps can be bypassed (**up to 12% incline in the room**)
- Paths are at least 120 cm wide, with a turning circle of at least 150 cm in diameter at the end of paths and at changes of direction
- Passageways are at least 90 cm wide; paths are free of obstacles
- Clear passage heights of at least 210 cm
- Floor coverings are slip-resistant and firmly laid
- Consistent signage or easy to find your way around
- Barrier-free areas marked with symbols
- Signage is well lit, no reflections
- Information accessible from a short reading distance, even for wheelchair users

## Steps in the exhibition area

- Straight steps, at least 120 cm wide, **29 cm deep** (standard minimum 30 cm)
- Steps max. 16 cm high, all steps the same height
- No protruding slab steps
- Entrance and exit steps with contrasting colours on the front edge
- Handrail on both sides, **at a height of 100 cm** (standard 85 - 90 cm)
- Secure to grip, **extending horizontally for at least 30 cm at both ends of the steps**



Exhibition area with slope

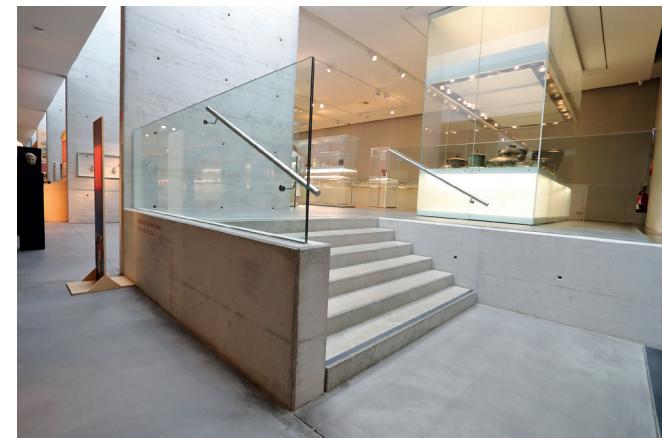

Steps in the exhibition area

## EXHIBITION

- Room and area texts at a height of 100–160 cm
- Object texts at a height of 120–140 cm (**flat texts are not avoided**)
- Object texts **not large and easily legible**
- Seating available in the exhibition area (height 46–50 cm, **no sturdy armrests or backrests**)
- Space in front of display cases with a diameter of at least 150 cm
- **Display cases not easily visible**

## INFORMATION FOR BLIND AND VISUALLY IMPAIRED PEOPLE

### PARKING SPACES AND TICKET OFFICE AT PARK ENTRANCE

- Parking spaces **parallel to the road**
- gate to the park is usually open
- **Ticket office not tactile** (no floor guidelines)
- Counter stands out visually from its surroundings, easily recognisable
- Cash desk counter is glare-free and illuminated in accordance with the area of use
- Information at the ticket office is **not tactile**

### ACCESSIBLE TOILET AT THE ENTRANCE TO THE PARK/CASH DESK

- Separately located (unisex)
- Toilet door: automatic sliding glass door
- The toilet door opens outwards and can be unlocked from the outside in an emergency.
- Door handle stands out in contrast to adjacent components
- **Fittings do not stand out visually from their surroundings**

### PATH THROUGH THE PARK AND ENTRANCE TO THE ARCHAEOLOGY MUSEUM

- Path free of obstacles
- Pavement edges are easily detectable with a white cane (different surfaces)
- **No tactile floor guidance system available**
- Clear height under signs is at least 220 cm
- Path is continuously lit
- The accessible entrance is the main entrance
- Entrance is easy to find, covered and free of obstacles
- **Door difficult to open, door closer**
- Door handle contrasts with adjacent components
- Glass door, marked with sufficient contrast, door opening side marked

### CASH DESK AND CLOAKROOM

- **Cash desk and cloakroom not tactilely locatable (no floor guidelines)**
- **Cash desk does not stand out visually from its surroundings, not easily recognisable**
- Cash desk is glare-free and illuminated in accordance with the area of use
- Information at the cash desk **not tactile**
- **Door to cloakroom not clearly perceptible**
- Door easy to open, **door closer**
- Door handle contrasts with adjacent components

## BARRIER-FREE TOILET

- The accessible toilet is also a ladies' toilet.
- Can be opened with a Eurokey!
- **No tactile floor guidance system to the toilet**

### Door to the toilet facilities

- **Door not clearly perceptible**
- **Door handle does not contrast with adjacent components**
- Door easy to open, **door closer**
- Door free of obstacles

### Toilet

- WC door opens outwards and can be unlocked from the outside in an emergency
- **Door handle does not contrast with adjacent components**
- Door easy to open; tactile signage attached
- Emergency bell available (alarm on site and also leads to reception)
- **Emergency bell cannot be reached from a seated position in the WC**
- **Emergency bell cannot be reached from the floor at a height of max. 35 cm above the floor**
- **Emergency bell is not designed to contrast and is not tactile**
- **Fittings do not stand out visually from their surroundings**

## INTERIOR AREA

- **No tactile floor guidance system**
- Paths are free of obstacles
- Clear passage heights of at least 210 cm
- No fixtures protruding more than 15 cm into the walking area
- **Glass walls along the paths are not marked with contrasting colours and are not clearly recognisable**
- Ramp with a **gradient of up to 12%** to avoid steps
- **Step and ramp intersections not marked with high contrast**
- **Floor coverings do not stand out visually from other building components**
- Lighting is adequate and appropriate for the area of use
- Consistent signage, making it easy to find your way around
- **Room labels and markings are not tactile**
- Signage is high-contrast, well-lit, no reflections
- Hazardous areas are not tactile and high-contrast

## Steps in the exhibition area

- Steps are straight, at least 120 cm wide, **29 cm deep** (standard minimum 30 cm)
- Steps max. 16 cm high, all steps the same height
- No protruding slab steps

- Entrance and exit steps with contrasting colours on the front edge
- Handrail on both sides, **at a height of 100 cm** (standard 85 - 90 cm)
- Easy to grip, **not extending horizontally for at least 30 cm at both ends of the steps**
- Handrails stand out clearly from the background
- **No tactile handrail information**

## EXHIBITION

- Exhibition rooms evenly lit and glare-free
- **No audio guide with audio description for blind and visually impaired people**
- **Exhibition and object texts are not tactile**
- Texts designed with high contrast, well lit, in easily legible font (**but not large**)
- **No tactile models available in the permanent exhibition**
- **Information and exhibition texts not designed according to the dual-sense principle (visual-tactile or visual-auditory)**
- **No magnifying glasses available for loan**

## INFORMATION FOR HEARING-IMPAIRED AND DEAF PEOPLE

- **No inductive hearing system** at the ticket office
- Rooms are evenly lit and glare-free
- **Information and exhibition texts not in accordance with the dual-sensory principle (visual-tactile or visual-auditory)**
- Exhibition texts: in easily legible font (**but not large**), high contrast, well lit
- **Guided tours with sign language interpreters cannot be offered**
- **There is no visible alarm.**

## INFORMATION FOR ALLERGY SUFFERERS

- The entire Archaeology Museum is free of dust-prone carpets, curtains and upholstered furniture

As of June 2025, all information subject to change

Source: [http://www.bereit-fuer-barrierefreiheit.eu/de/Betriebe/?xt=CEDOSCheckResults&xtMethod=showDataset&cat\\_id=1634&tobj\\_id=3185](http://www.bereit-fuer-barrierefreiheit.eu/de/Betriebe/?xt=CEDOSCheckResults&xtMethod=showDataset&cat_id=1634&tobj_id=3185)

Photos: UMJ, UMJ – Max Wegscheidler